


AREA ABOVE THIS LINE FOR CUSTOMER CONDUITS TO POWER PANEL.

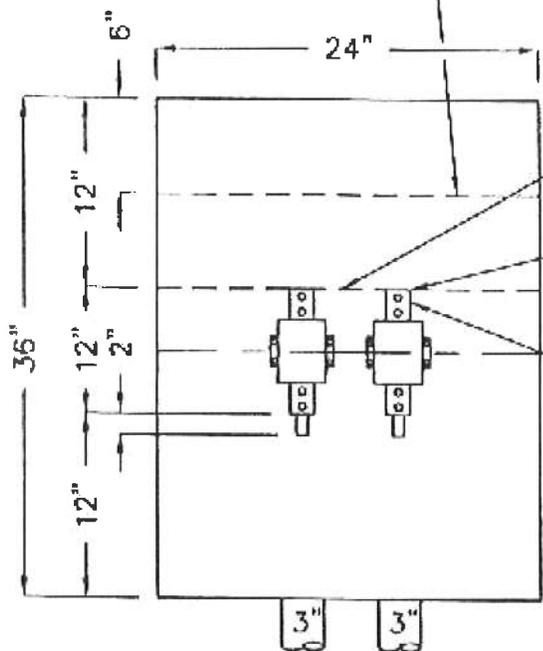

ELEVATION

CT CABINET

MAINTAIN MINIMUM OF 3' WORK AREA IN FRONT OF C.T. CABINET.

PLAN

AREA ABOVE THIS LINE FOR ROUTING OF CUSTOMER CABLE.

CUSTOMER TO TRAIN CABLES TO MINIMIZE TENSION ON CURRENT TRANSFORMER.

CUSTOMER CONNECTIONS, TYPICAL.

CABINET TO BE GROUNDED TO THE NEUTRAL.

600 AMP SERVICE 2-3" SERVICE CONDUITS, CONDUITS FOR INCOMING LINE MUST ENTER THROUGH THE BOTTOM AS SHOWN UNLESS WRITTEN PERMISSION IS OBTAINED FROM EASTON UTILITIES COMMISSION.

ALL BOXES TO BE MINIMUM OF 16-GAUGE STEEL, NEMA 1 FOR INDOOR OR NEMA 3R FOR OUTDOOR, 10" MINIMUM DEPTH, HINGED DOOR, POSITIVE LATCH WITH PADLOCK EYE. GROUNDED MOUNTING - ADJUSTABLE ASSEMBLY OF VERTICAL AND HORIZONTAL BARS.

CURRENT TRANSFORMER CABINET :

INDOOR - CABINET FURNISHED BY EUC AND INSTALLED BY OWNER.

OUTDOOR - CABINET FURNISHED AND INSTALLED BY OWNER.

APPROVAL

REVISED

TOWN OF EASTON
AND
EASTON UTILITIES COMMISSION
STANDARD DETAILS
1Ø CURRENT TRANSFORMER
CABINET

Talbot Whone 4/25/00
EU MANAGER OF ENGINEERING DATE

ISSUED

STANDARD No. E-2.00