Y:\0000\CADD STANDARDS\DETAILS\City Details\Easton MD\DETAILS\PW-1.02.dwg Dec 22 , 2010 - 1:40pm, (batn)

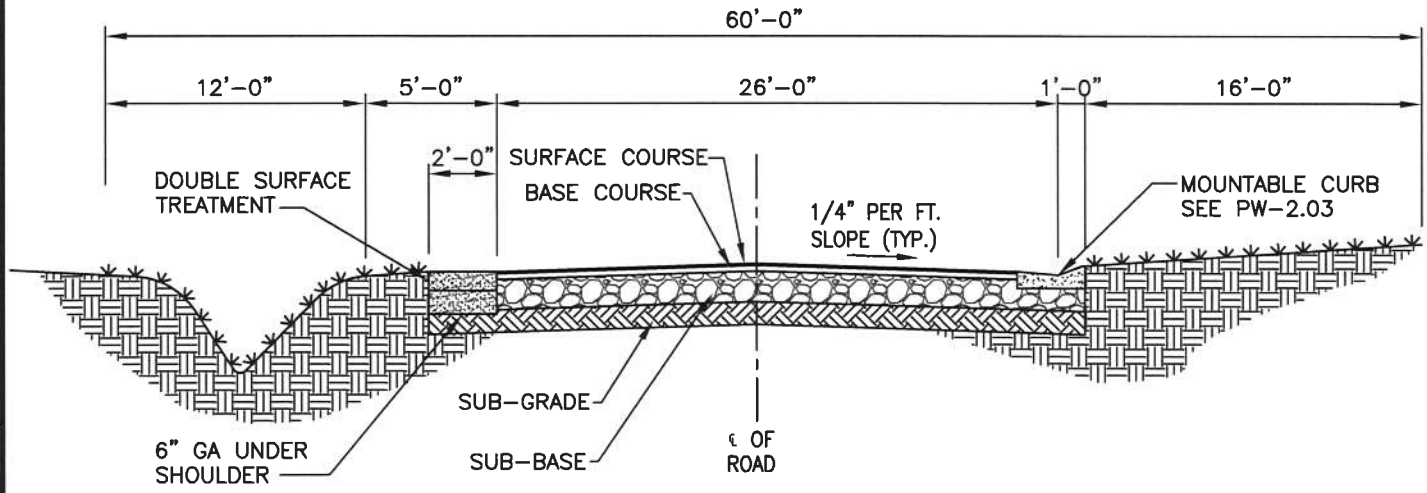

NOTES:

1. PROVIDE 4" MIN. TOPSOIL, FERTILIZE, SEED & MULCH ALL DISTURBED AREAS ON BOTH SIDES.

2. PAVING:
   BITUMINOUS CONCRETE (MINIMUM)
   SURFACE COURSE 1.5" 'SF' OR SUPERPAVE 9.5MM
   BASE COURSE 2.5" 'BC' OR SUPERPAVE 19.0MM

3. SUBBASE:
   6" GRADED AGGREGATE COMPACTED TO 95% OF ASTM D1557, MODIFIED PROCTOR METHOD.

4. SUBGRADE:
   COMPACT APPROVED SUBGRADE TO 95% OF ASTMD1557 – CBR TESTING SHALL BE PERFORMED ON THE SUB-GRADE AND APPROVED BY THE TOWN ENGINEER PRIOR TO THE START OF CONSTRUCTION PRIOR TO CONSTRUCTION DOCUMENT APPROVAL.

5. ENTIRE 60' WIDTH SHALL BE CLEARED AND GRADED AS SHOWN.

6. MOUNTABLE CURB OR 2' WIDE DOUBLE SURFACE TREATMENT MAY BE REQUIRED AT THE DISCRETION OF THE TOWN ENGINEER.

APPROVAL

TOWN ENGINEER — DATE 4/12/11

REVISED
AUG. 1, 94
MAR 1, 98
AUG. 1, 01
SEP 1, 02
FEB 25, 09
JAN 1, 11

ISSUED: MAY 1, 1986

TOWN OF EASTON
AND
EASTON UTILITIES
STANDARD DETAILS

RESIDENTIAL COLLECTOR STREET

STANDARD NO. PW-1.02