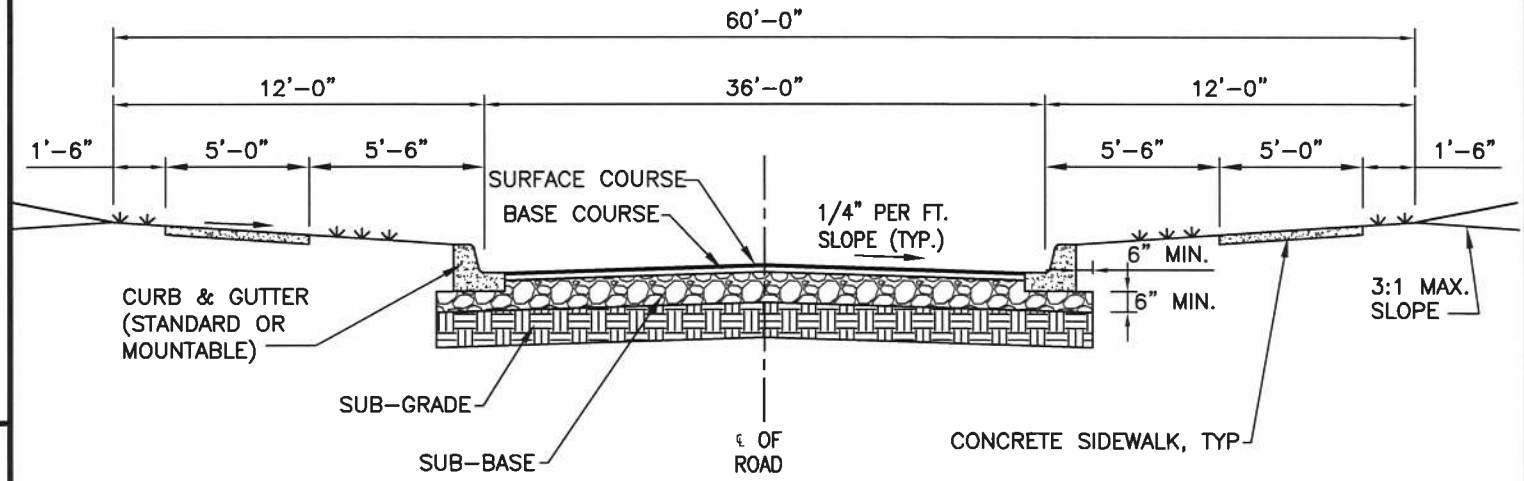

NOTES:

1. PROVIDE 4" MIN. TOPSOIL, FERTILIZE, SEED & MULCH ALL DISTURBED AREAS ON BOTH SIDES.

2. PAVING:
   BITUMINOUS CONCRETE (MINIMUM)
   SURFACE COURSE 1.5" 'SF' OR SUPERPAVE 9.5MM
   BASE COURSE 4" 'BC' OR SUPERPAVE 19.0MM, PLACED IN TWO (2) 2" COURSES.

3. SUBBASE:
   SHA BRG SUBBASE PLACED AND COMPACTED IN TWO (2) COURSES OR 9" GRADED AGGREGATE COMPACTED TO 95% OF ASTM D1557, MODIFIED PROCTOR METHOD.

4. SUBGRADE:
   COMPACT APPROVED SUBGRADE TO 95% OF ASTMD1557 – CBR TESTING SHALL BE PERFORMED ON THE SUB-GRADE AND APPROVED BY THE TOWN ENGINEER PRIOR TO THE START OF CONSTRUCTION PRIOR TO CONSTRUCTION DOCUMENT APPROVAL.

5. ENTIRE 60' WIDTH SHALL BE CLEARED AND GRADED AS SHOWN.

6. 36' ROAD WIDTH IS MEASURED FROM FLOWLINE FOR STANDARD CURB AND GUTTER OR MOUNTABLE CURB. SEE STANDARD PW 2.03 FOR MOUNTABLE CURB DETAIL.

7. CROSS SLOPE FOR SIDEWALKS SHALL BE A MAXIMUM OF 2%. MINIMUM SLOPE SHALL BE AS REQUIRED FOR PROPER DRAINAGE (SEE PW-3.00 FOR SIDEWALK REQUIREMENTS).

APPROVAL

TOWN ENGINEER — DATE 4/12/11

REVISED
AUG. 1, 94
MAR 1, 98
SEP 1, 02
FEB 1, 06
FEB 25, 09
JAN 1, 11

ISSUED: MAY 1, 1986

TOWN OF EASTON
AND
EASTON UTILITIES
STANDARD DETAILS

COMMERCIAL LOCAL STREET

STANDARD NO. PW-1.04