


Y:\0000\CADD STANDARDS\DETAILS\City Details\Easton MD\DETAILS\PW-2.00.dwg Dec 22 , 2010 - 3:17pm, (batrn)

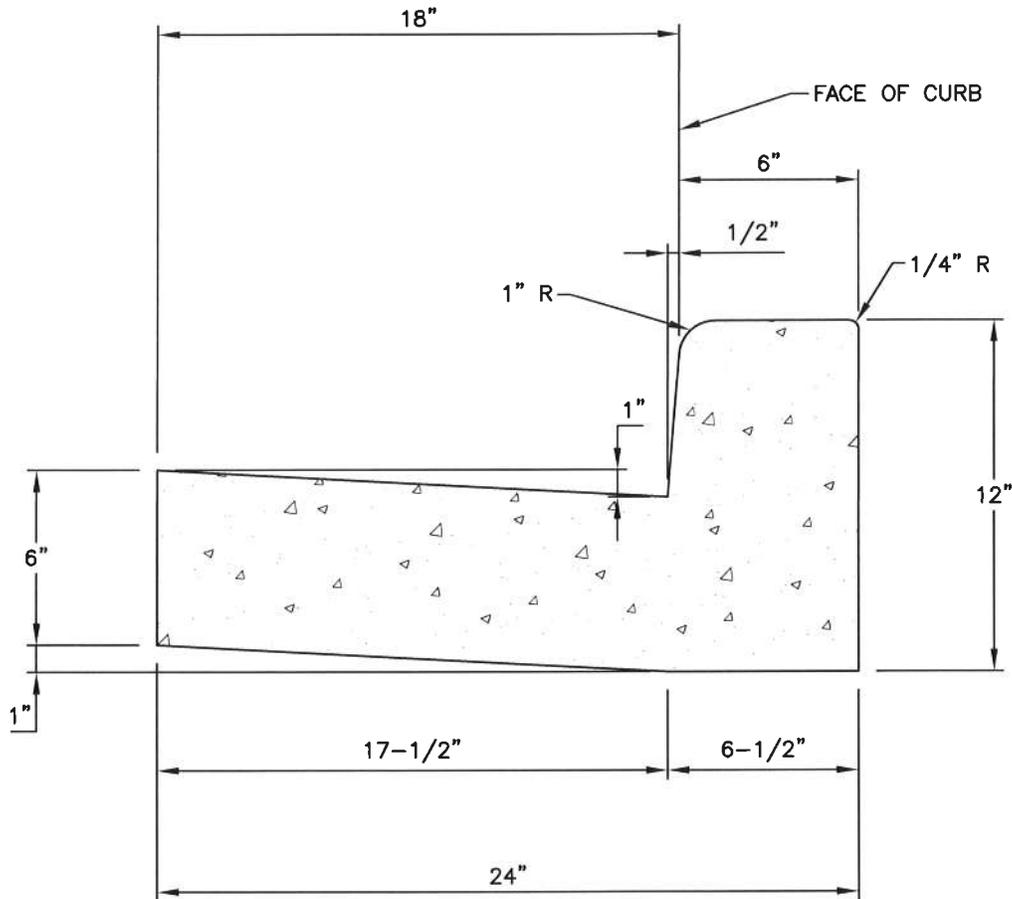

NOTES:

1. ALL CONCRETE USED FOR CURB & GUTTER SHALL BE SHA MIX NO. 7.
2. CURB & GUTTER SHALL HAVE CONTRACTION JOINTS EVERY 10'-0", AND EXPANSION JOINTS EVERY 40'-0". EXTRUDED CONCRETE CURB & GUTTER SHALL HAVE CONTRACTION JOINTS EVERY 10'-0", AND EXPANSION JOINTS EVERY 100'-0" AND AT PT OR PC.
3. DEPRESSED CURB AND GUTTER SHALL BE UTILIZED AT HANDICAPPED RAMPS WHEN TRANSITIONING FROM STANDARD CURB AND GUTTER.
4. MAXIMUM GUTTER SLOPE ON CURB RETURNS SHALL BE 2% WHERE HANDICAPPED RAMPS ARE REQUIRED.

<p>APPROVAL</p> <p><i>[Signature]</i> <u>4/12/11</u> TOWN ENGINEER DATE</p>	REVISED	<p>TOWN OF EASTON AND EASTON UTILITIES STANDARD DETAILS</p> <p>STANDARD CURB AND GUTTER</p>
	MAY 1, 89	
	AUG 1, 94	
	FEB 25, 09	
	JAN 1, 11	
ISSUED: MAY 1, 1986	STANDARD NO. PW-2.00	