


Y:\0000\CADD STANDARDS\DETAILS\City Details\Easton MD\DETAILS\PW-2.01.dwg Apr 04, 2011 - 3:37pm, (batn)

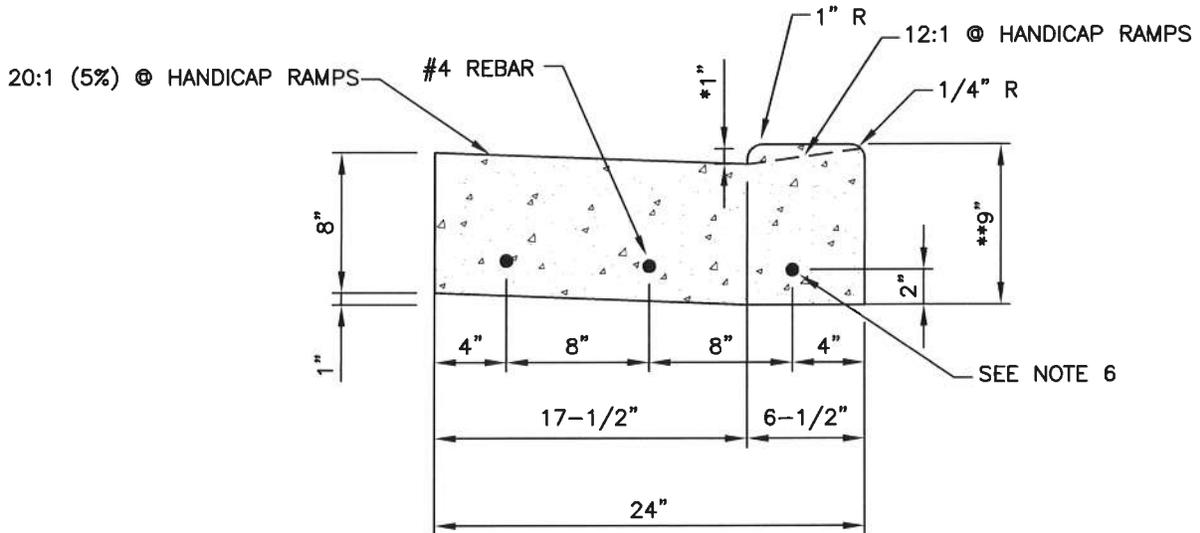

**DEPRESSED CURB**

NOTES:

1. ALL CONCRETE USED FOR CURB & GUTTER SHALL BE SHA MIX NO. 7.
2. CURB & GUTTER SHALL HAVE CONTRACTION JOINTS EVERY 10'-0", AND EXPANSION JOINTS EVERY 40'-0". EXTRUDED CONCRETE CURB & GUTTER SHALL HAVE CONTRACTION JOINTS EVERY 10'-0", AND EXPANSION JOINTS EVERY 100'-0".
- \*3. RISE AT H/C RAMPS SHALL BE 7/8".
- \*\*4. CURB HEIGHT AT H/C RAMPS SHALL BE 8 1/2".
5. MAXIMUM GUTTER SLOPE ON CURB RETURNS SHALL BE 2% WHERE HANDICAPPED RAMPS ARE REQUIRED.
6. ALL DRIVEWAYS AND HANDICAP RAMPS REQUIRE 3 PIECES OF EPOXY COATED #6 REBAR, EQUALLY SPACED THE FULL WIDTH OF THE DEPRESSED CURB.

<p>APPROVAL</p> <p><i>[Signature]</i> 4/12/11 TOWN ENGINEER DATE</p>	REVISED	<p>TOWN OF EASTON AND EASTON UTILITIES STANDARD DETAILS STANDARD DEPRESSED CURB AND GUTTER</p>
	MAY 1, 89	
	AUG 1, 94	
	MAR 26, 07	
	FEB 25, 09	
ISSUED: MAY 1, 1986	JAN 1, 11	STANDARD NO. PW-2.01