




Y:\0000\CADD STANDARDS\DETAILS\City Details\Easton MD\DETAILS\PW-2.02.dwg Apr 04, 2011 - 3:38pm, (batn)

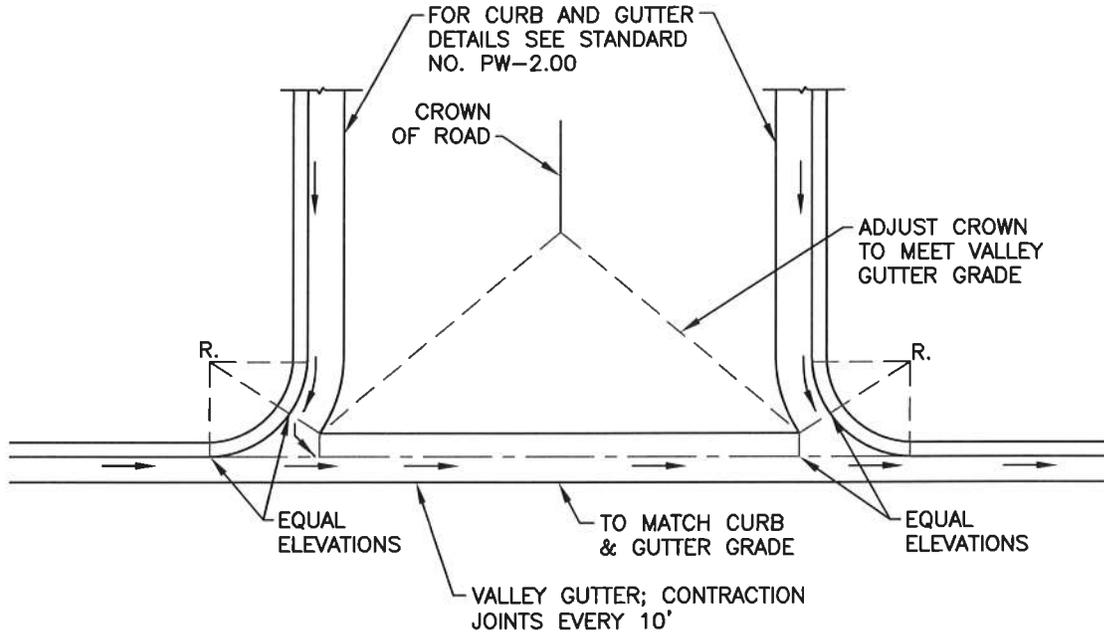

CONCRETE SHALL BE SHA MIX NO. 3 REINFORCED WITH EPOXY COATED NO. 6 DEFORMED REINFORCING BAR AS SHOWN

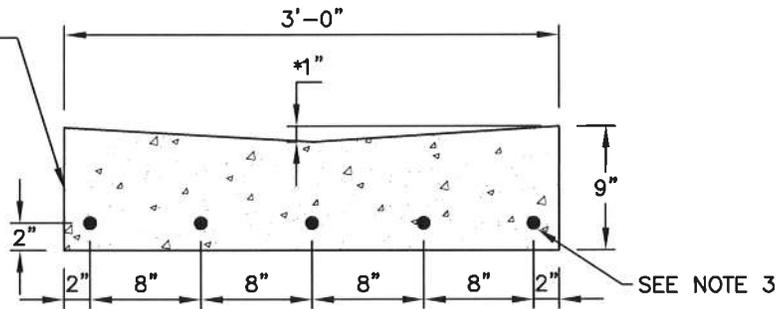

- NOTE:
1. DO NOT UTILIZE AT HANDICAP RAMP UNLESS SURFACE SLOPE  $\leq$  20:1 (5%)
  - \*2. RISE AT H/C RAMPS SHALL BE  $\frac{7}{8}$ "
  3. ALL DRIVEWAYS AND HANDICAP RAMPS REQUIRE 5 PIECES OF EPOXY COATED #6 REBAR, EQUALLY SPACED THE FULL WIDTH OF THE DEPRESSED CURB.

<b>APPROVAL</b>  TOWN ENGINEER	<b>REVISED</b> OCT 1, 88	TOWN OF EASTON AND EASTON UTILITIES STANDARD DETAILS VALLEY GUTTER AND INTERSECTION DETAIL
	AUG 1, 94	
	MAR 1, 98	
	FEB 1, 06	
	FEB 25, 09	
ISSUED: MAY 1, 1986	JAN 1, 11	STANDARD NO. PW-2.02