


Y:\0000\CADD STANDARDS\DETAILS\City Details\Easton MD\DETAILS\PW-2.04.dwg Apr 05, 2011 - 11:26am, (batn)

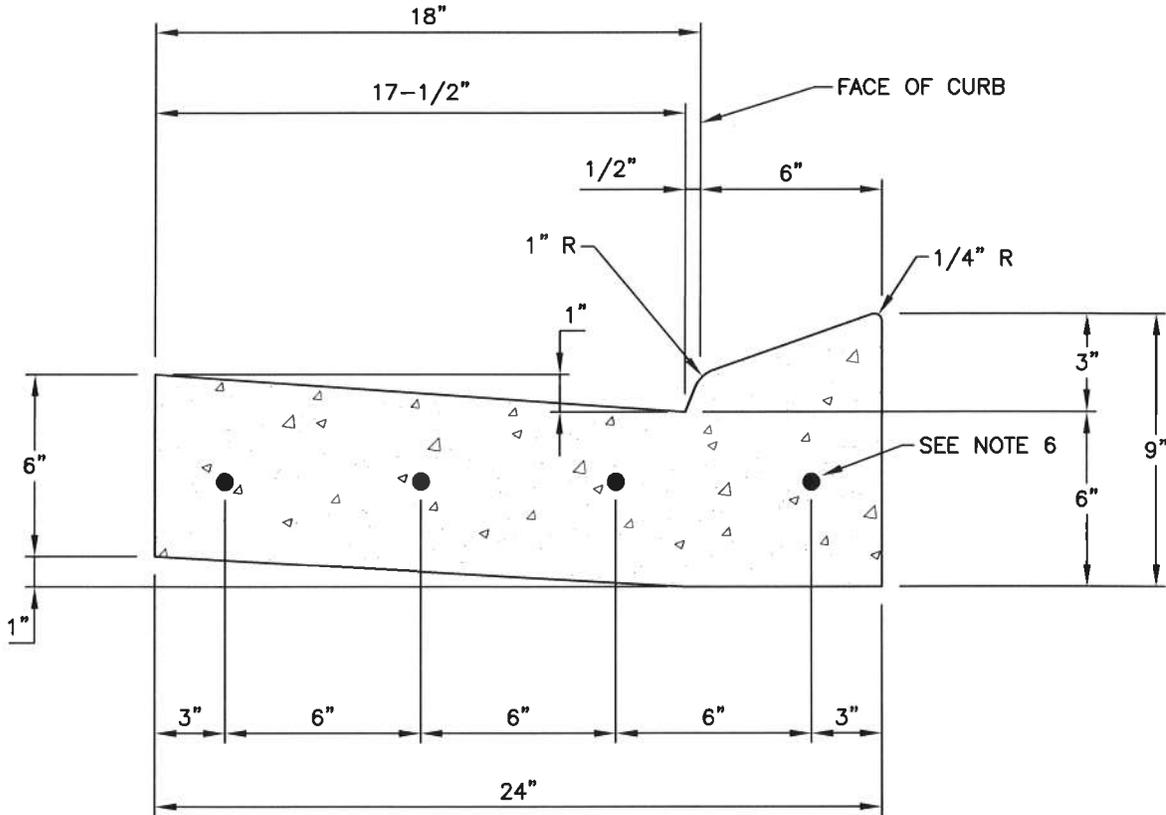

**NOTES:**

1. ALL CONCRETE USED FOR CURB & GUTTER SHALL BE SHA MIX NO. 7.
2. CURB & GUTTER SHALL HAVE CONTRACTION JOINTS EVERY 10'-0", AND EXPANSION JOINTS EVERY 40'-0". EXTRUDED CONCRETE CURB & GUTTER SHALL HAVE CONTRACTION JOINTS EVERY 10'-0", AND EXPANSION JOINTS EVERY 100'-0" AND AT PT OR PC.
3. DEPRESSED CURB AND GUTTER SHALL BE UTILIZED AT HANDICAPPED RAMPS WHEN TRANSITIONING FROM MEDIAN CURB AND GUTTER.
4. MAXIMUM GUTTER SLOPE ON CURB RETURNS SHALL BE 2% WHERE HANDICAPPED RAMPS ARE REQUIRED.
5. MEDIAN CURB AND GUTTER TO BE USED AT MEDIANS ONLY. SEE PW-4.06 FOR MEDIAN RAMP DETAIL.
6. ALL DRIVEWAYS AND HANDICAP RAMPS REQUIRE 4 PIECES OF EPOXY COATED #6 REBAR, EQUALLY SPACED THE FULL WIDTH OF THE DEPRESSED CURB.

<b>APPROVAL</b>	<b>REVISED</b>	<b>TOWN OF EASTON AND EASTON UTILITIES STANDARD DETAILS</b>  <b>MEDIAN CURB AND GUTTER</b>
 TOWN ENGINEER		
4/12/11 DATE		
<b>ISSUED: JANUARY 1, 2011</b>		<b>STANDARD NO. PW-2.04</b>