


Y:\0000\CADD STANDARDS\DETAILS\City Details\Easton MD\DETAILS\PW-4.00.dwg Sep 17, 2014 - 10:56am, (merf)

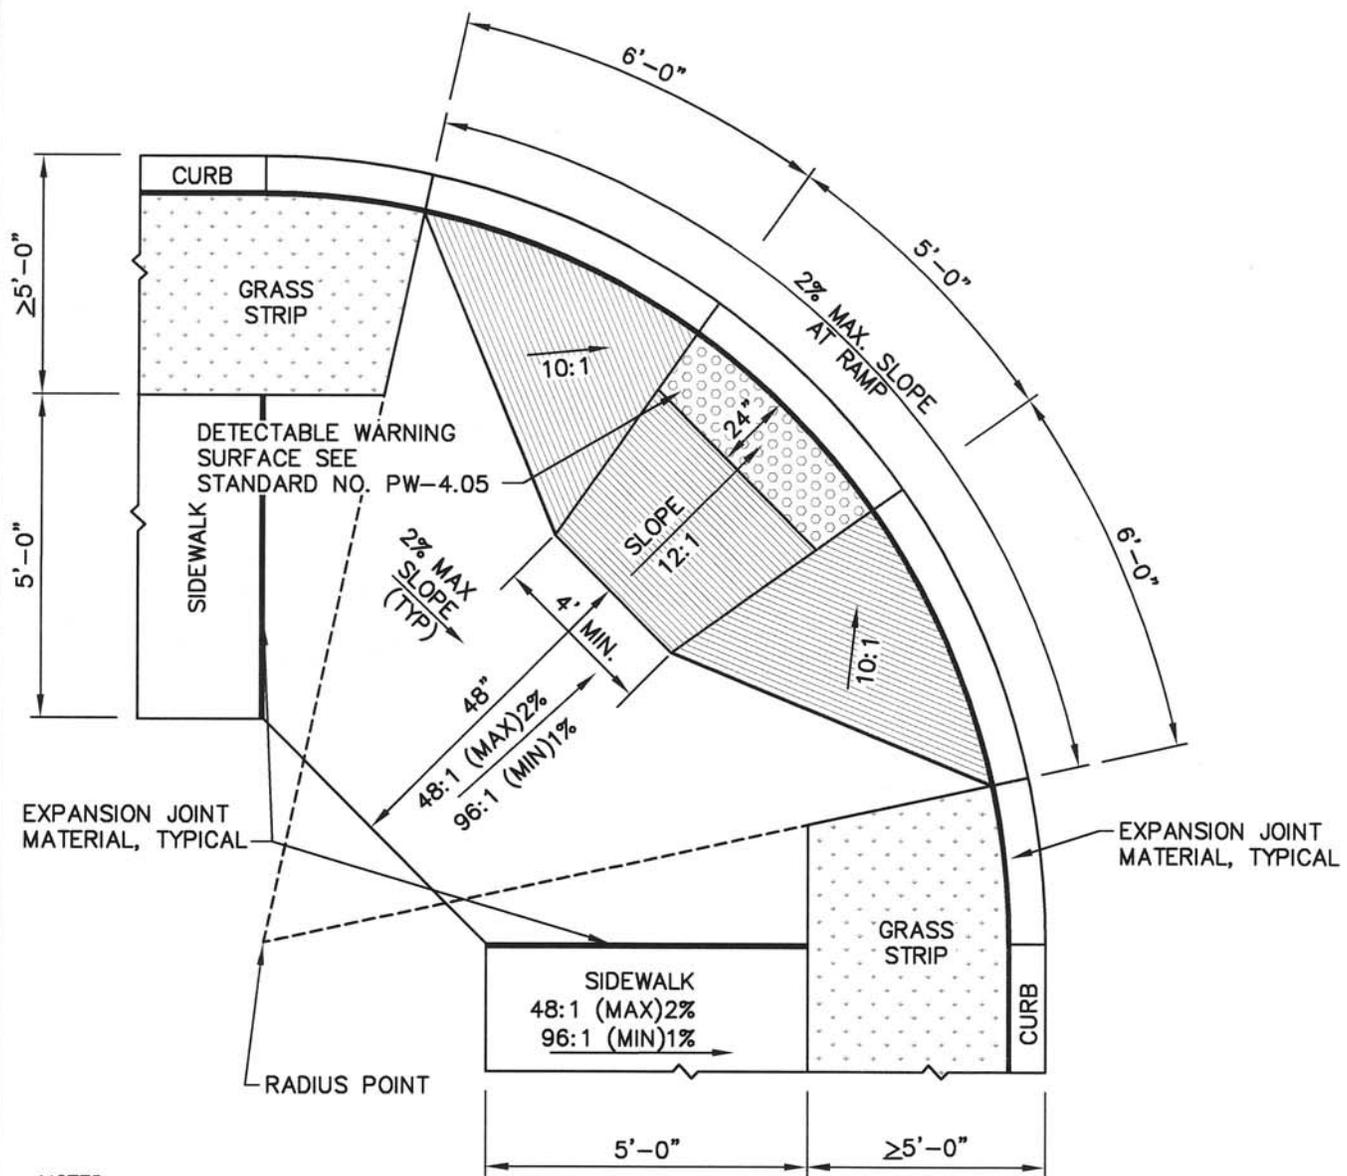

**NOTES:**

1. SURFACE TEXTURE OF RAMPS SHALL BE COARSE BROOMING OR NON-SKID TYPE SURFACE.
2. SEE STANDARD NO. PW-2.01 FOR DEPRESSED CURB.
3. MAX SLOPE FOR RAMP SHALL BE 12:1.
4. HANDICAPPED RAMPS INCLUDING CURB AND GUTTERS SHALL BE REINFORCED WITH 6x6 W1.4xW1.4 WELDED WIRE MESH.
5. HANDICAPPED RAMPS SHALL CONTAIN A 6" THICK CONCRETE SECTION.
6. AT NO POINT SHALL THE SLOPE OF THE LANDING BE GREATER THAN 48:1 (2%), INCLUDING DIAGONAL.

|  |  |  |
|--|--|--|
| <p><b>APPROVAL</b></p> <p><i>[Signature]</i><br/>TOWN ENGINEER</p> <p>9/17/14<br/>DATE</p> | <p><b>REVISED</b></p> <p>MAR 1, 98</p> <p>FEB 1, 02</p> <p>MAR 26, 07</p> <p>FEB 25, 09</p> <p>JAN 1, 11</p> <p>SEP 17, 14</p> | <p>TOWN OF EASTON<br/>AND<br/>EASTON UTILITIES<br/>STANDARD DETAILS</p> <p><b>TYPE "A" SIDEWALK RAMP</b></p> |
| <p><b>ISSUED: MAY 1, 1986</b></p>  | <p><b>STANDARD NO. PW-4.00</b></p>   |  |