


Y:\0000\CADD STANDARDS\DETAILS\City Details\Easton MD\DETAILS\PW-4.10.dwg Apr 04 , 2011 - 3:56pm, (batn)

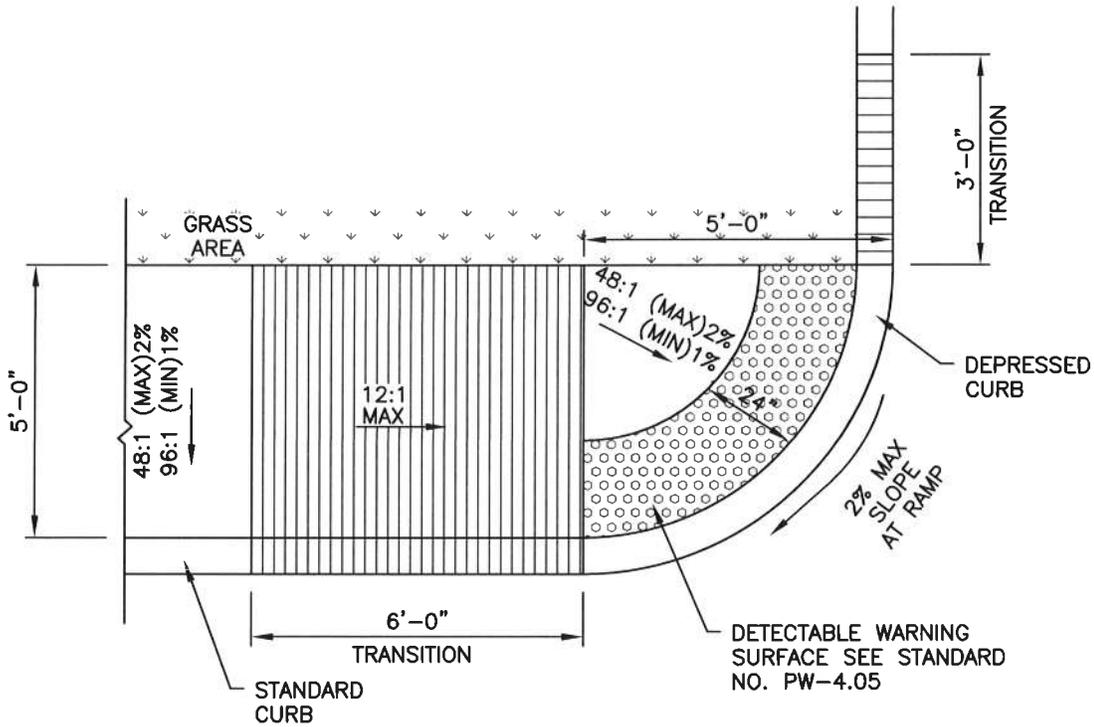

NOTES:

1. SURFACE TEXTURE OF RAMPS SHALL BE COARSE BROOMING OR NON-SKID TYPE SURFACE.
2. SEE STANDARD NO. PW-2.01 FOR DEPRESSED CURB.
3. SEE STANDARD NO. PW-2.00 FOR STANDARD CURB.
4. BRICK SIDEWALK AND HANDICAP RAMPS SHALL BE USED AS DIRECTED BY THE TOWN. SEE STANDARD NO. PW-3.01 FOR BRICK SIDEWALK DETAIL.
5. HANDICAPPED RAMPS SHALL BE REINFORCED WITH 6x6 W1.4xW1.4 WELDED WIRE MESH.
6. HANDICAPPED RAMPS SHALL CONTAIN A 6" THICK CONCRETE SECTION.
6. AT NO POINT SHALL THE SLOPE OF THE LANDING BE GREATER THAN 48:1 (2%), INCLUDING DIAGONAL.
7. THERE SHALL BE A LANDING PRIOR TO THE RAMPS. THE LANDING SHALL BE 36" IN LENGTH, MINIMUM.

<p>APPROVAL</p> <div style="text-align: center;"> TOWN ENGINEER </div>	<p>REVISED</p> <p>JAN 1, 11</p>	<p>TOWN OF EASTON AND EASTON UTILITIES STANDARD DETAILS</p> <p>TYPE "G" SIDEWALK RAMP</p>
<p>ISSUED: MAY 14, 2009</p>		<p>STANDARD NO. PW-4.10</p>