


Y:\0000\GADD STANDARDS\DETAILS\City Details\Easton MD\DETAILS\SD-6.00.dwg Dec 29 , 2010 - 2:53pm, (batm)

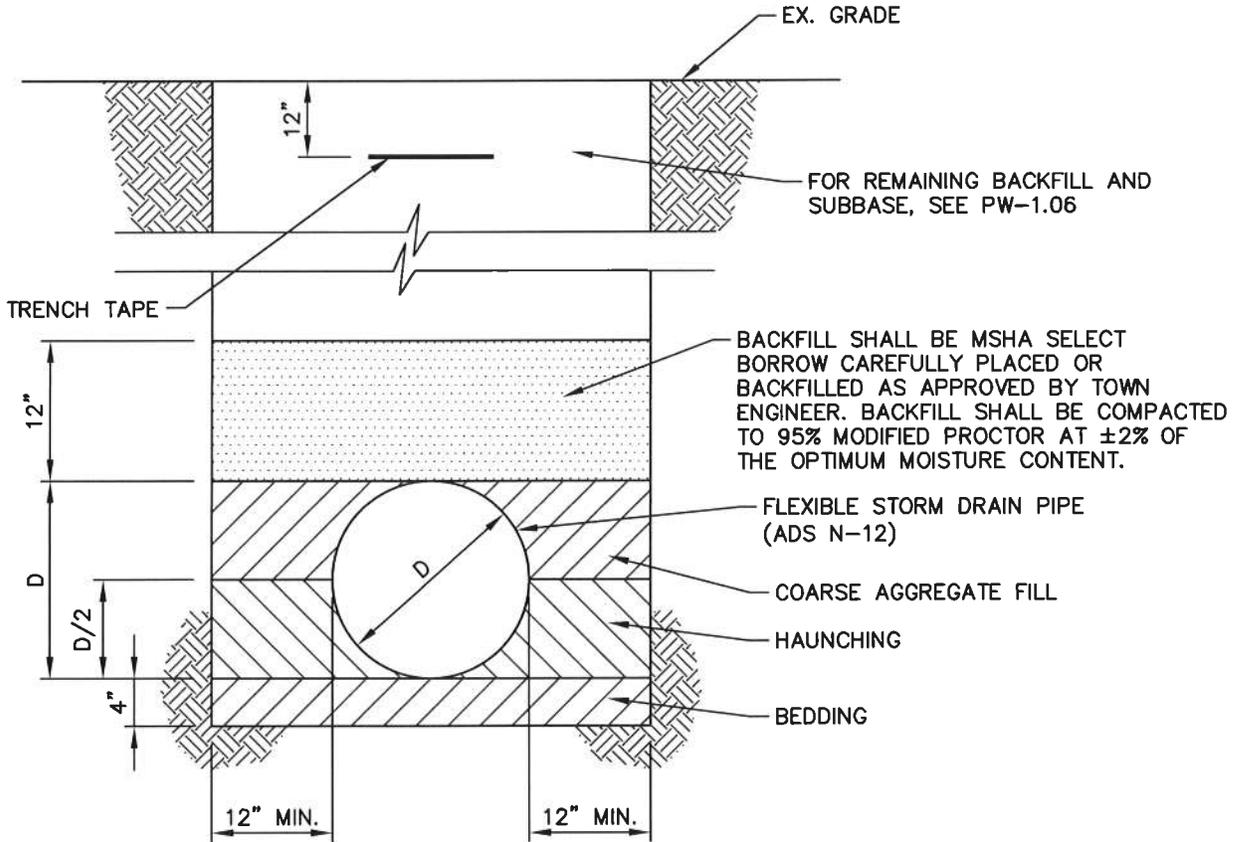

NOTES:

1. BEDDING, HAUNCHING AND FILL MATERIAL TO THE TOP OF THE PIPE SHALL BE COARSE AGGREGATE MEETING THE REQUIREMENTS OF ASSHTO M43-SIZE NUMBER 57.
2. DURING HAUNCHING, CONTRACTOR SHALL CAREFULLY WORK GRAVEL DOWN AROUND THE BOTTOM OF THE PIPE.
3. RCP SHALL BE UTILIZED UNDER ALL PAVED AREAS.

<b>APPROVAL</b>	
<i>M. Fundel</i> TOWN ENGINEER	4/12/11 DATE

<b>REVISED</b>
JAN 1, 11

TOWN OF EASTON  
AND  
EASTON UTILITIES  
STANDARD DETAILS  
FLEXIBLE STORM DRAIN  
PIPE TRENCH

ISSUED: FEB 25, 2009

STANDARD NO. SD-6.00