


Y:\0000\CADD STANDARDS\DETAILS\City Details\Easton MD\DETAILS\SS-7.00.dwg Dec 29 , 2010 - 2:55pm, (batm)

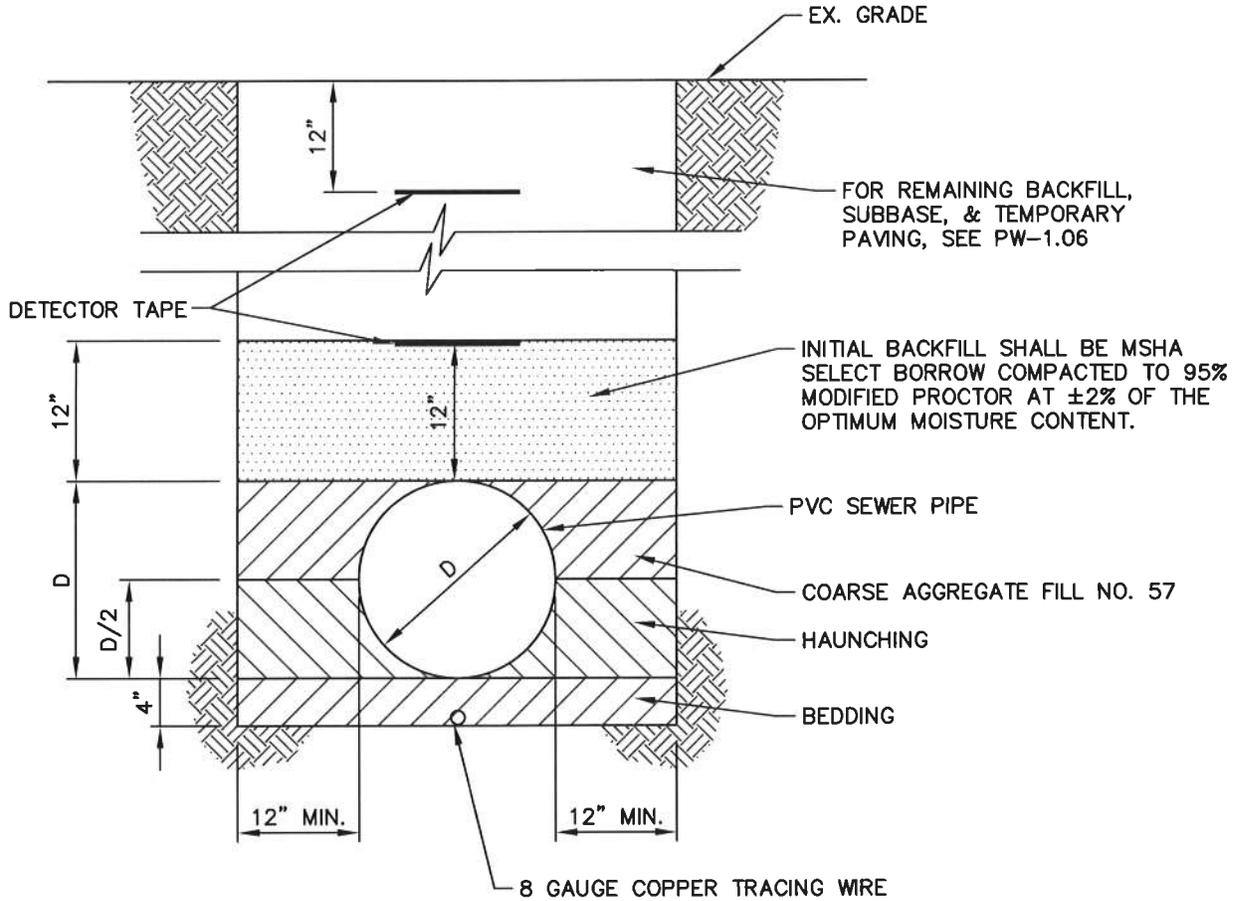

NOTES:

1. BEDDING, HAUNCHING AND FILL MATERIAL TO THE TOP OF THE PIPE SHALL BE COARSE AGGREGATE MEETING THE REQUIREMENTS OF ASSHTO M43—SIZE NUMBER 57.
2. DURING HAUNCHING, CONTRACTOR SHALL CAREFULLY WORK GRAVEL DOWN AROUND THE BOTTOM OF THE PIPE.
3. ADD DETECTOR TAPE 12" ABOVE ALL PIPE AND 12" BELOW THE GROUND SURFACE.

APPROVAL		REVISED	TOWN OF EASTON AND EASTON UTILITIES STANDARD DETAILS PVC SEWER MAIN TRENCH
 TOWN ENGINEER	4/12/11	OCT 11, 10	
	DATE	JAN 1, 11	
ISSUED: FEB 25, 2009		STANDARD NO. SS-7.00	