


Y:\0000\CADD STANDARDS\DETAILS\City Details\Easton MID\DETAILS\W-4.00.dwg Apr 05, 2011 - 4:26pm, (batn)

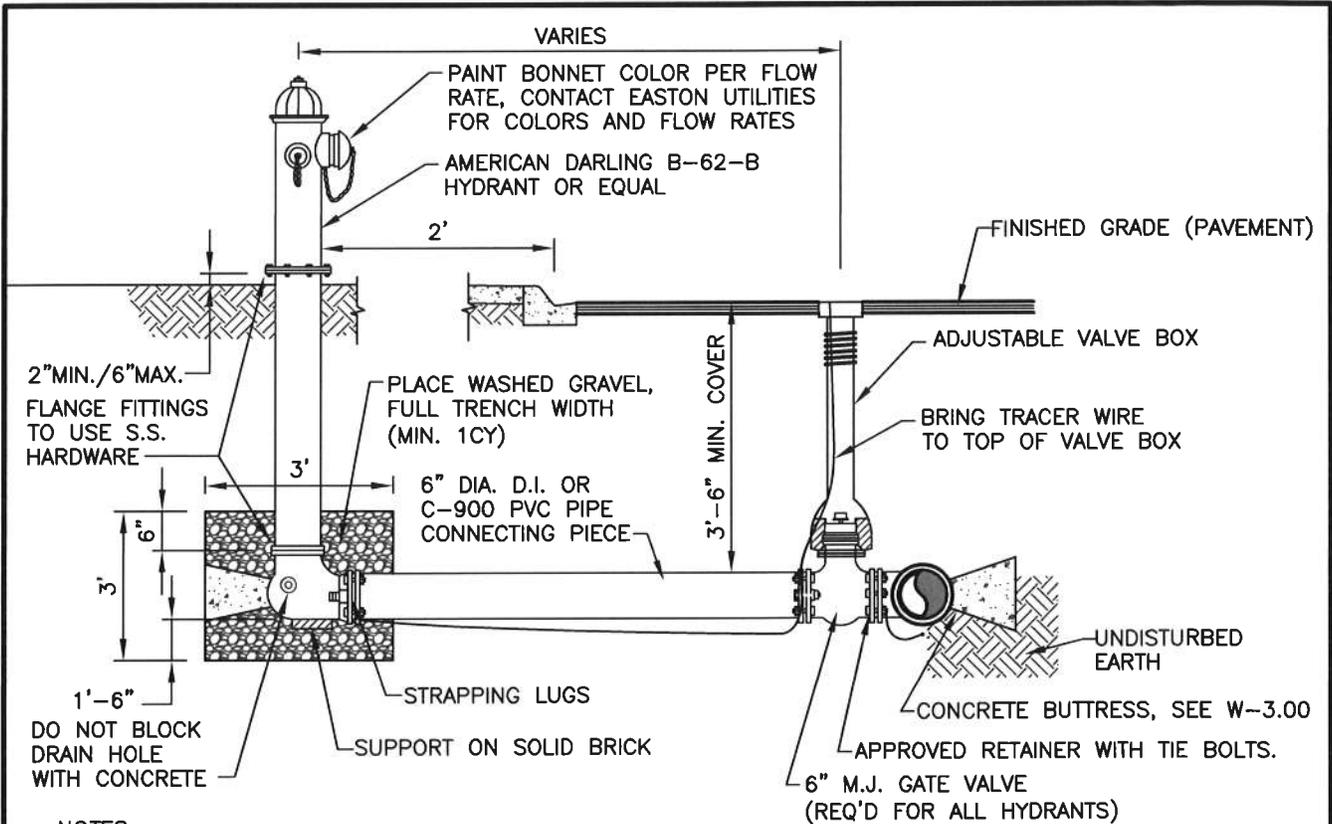

NOTES:

1. FIRE HYDRANT SPECIFICATIONS:
 TRAFFIC TYPE, PAINTED GREEN, OPEN LEFT
 OPERATING NUT - HEXAGON 1½" FLAT TO FLAT
 MECHANICAL JOINT BASE - 6"
 BRONZE LINED
 4" STEAMER NOZZLE - 6 THDS./INCH STYLE 60°
 4.793" PITCH DIA.
 2-2½ - HOSE NOZZLES - HOSE THD. 3½" DIA. 8 THDS/INCH
2. GATE VALVE SPECIFICATIONS:
 SHALL CONFORM TO AWWA STANDARD C-600
 SHALL BE IRON BODY, BRONZE MOUNTED TYPE AND HAVE
 NON-RISING STEM, OPENING BY TURNING RIGHT (CLOCKWISE)
 RESILIENT SEAT VALVE
3. FIRE HYDRANT SHALL BE INSTALLED AS SHOWN AT THE PROPERTY LINE BETWEEN ADJOINING LOTS.
4. HYDRANT SPACING SHALL BE 750' MAX. AS MEASURED ON IMPROVED WAY FOR SINGLE FAMILY RES.
 375' MAX FOR MULTI-FAMILY, COMMERCIAL, ETC.
5. WHEN INDICATED BY EUC, DRAIN PORT SHALL BE PLUGGED BY CONTRACTOR.
6. REINFORCED COATED TRACER WIRE AS MANUFACTURED BY COPPERHEAD INDUSTRIES, LLC. P.O. BOX
 1081, MONTICELLO, MN, 55362, OR AN APPROVED EQUAL.
7. THOROUGHLY TAPE MECHANICAL CONNECTIONS WITH ELECTRICAL TAPE.

<p>APPROVAL</p> <div style="border-bottom: 1px solid black; width: 80%; margin-bottom: 5px;"></div> <div style="display: flex; justify-content: space-between;"> <div style="text-align: center;"> TOWN ENGINEER </div> <div style="text-align: center;"> 4/12/11 DATE </div> </div>	<p>REVISED</p> <p>JAN 1, 11</p> <div style="border-bottom: 1px solid black; width: 80%; margin-bottom: 5px;"></div> <div style="border-bottom: 1px solid black; width: 80%; margin-bottom: 5px;"></div>	<p>TOWN OF EASTON AND EASTON UTILITIES STANDARD DETAILS</p> <p>FIRE HYDRANT</p>
<p>ISSUED: FEB 25, 2009</p>		<p>STANDARD NO. W-4.00</p>