


COVER

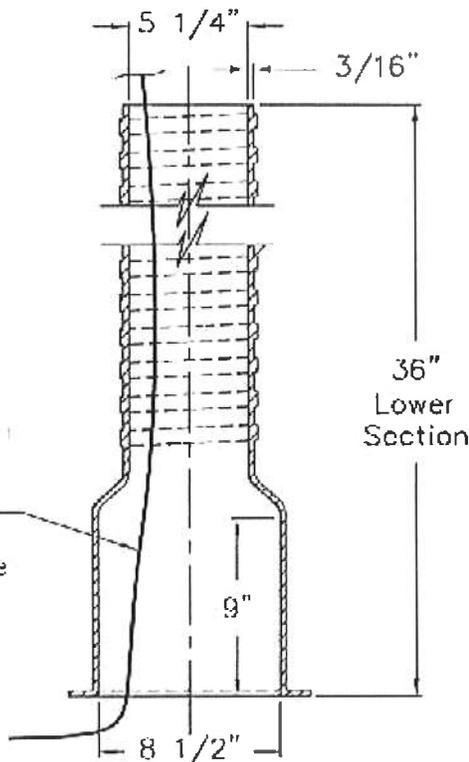

10 Gauge Reinforced Tracer Wire Through Valve Box As Shown

VALVE BOX SECTION

Notes:

1. To Be Plumb And Centered Over Valve.
2. All Sections Shown To Be Gray Iron Castings, Class No. 35 ASTM A-48.
3. Lower Section To Rest On Valve Bonnet.
4. Valve Box To Be Fig. #1905 And As Manufactured By Bingham & Taylor P.O. Box 552 Culpeper, VA. 22701
5. Reinforced Coated Tracer Wire As Manufactured By Copperhead Industries, LLC, P.O. Box 1081 Monticello, MN, 55362, Or An Approved Equal.

APPROVAL	REVISED	TOWN OF EASTON AND EASTON UTILITIES STANDARD DETAILS SCREW TYPE VALVE BOX
 EU MANAGER OF ENGINEERING DATE	MAR 1, 98	
	SEP 1, 09	
ISSUED: AUG 1, 1994	STANDARD NO.	W-6.01