


PLAN

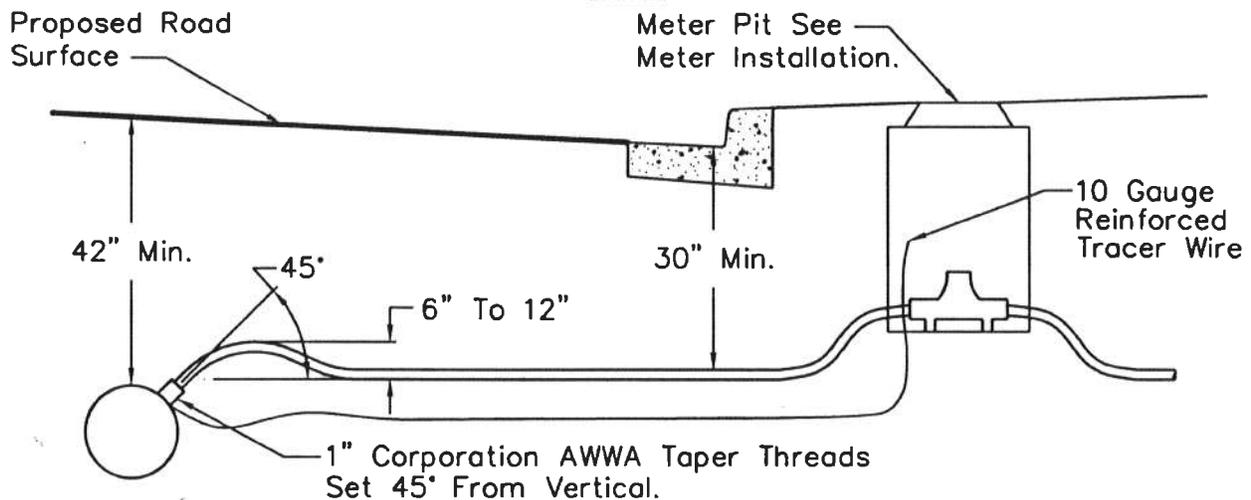

PROFILE

Notes:

1. Copper To Be Laid Level With Top Of Main Unless Otherwise Directed By Engineer.
2. Corporation Cock To Be Left Open, Meter Angle Valve Left Closed.
3. Add Detector Tape And Tracer Wire To All Pipe.
4. PE3408 Tubing Shall Be Manufactured By Orangeburg Inc., 946 Riverside Drive Asheville, NC 28804, Or An Approved Equal.
5. Backfill And Tamp With Select Material To Pad Pipe. See Detail W-1.00.
6. Reinforced Coated Tracer Wire As Manufactured By Copperhead Industries, LLC, P.O. Box 1081, Monticello, MN, 55362, Or An Approved Equal.
7. Thoroughly Tape Mechanical Connections With Electrical Tape.

APPROVAL	REVISED	TOWN OF EASTON AND EASTON UTILITIES STANDARD DETAILS DOUBLE SERVICE INSTALLATION
 EU MANAGER OF ENGINEERING DATE	AUG 1, 94	
	MAR 1, 98	
	FEB 1, 02	
	FEB 1, 06	
	SEP 1, 09	
ISSUED: <u>MAY 1, 1986</u>		STANDARD NO. W-7.00